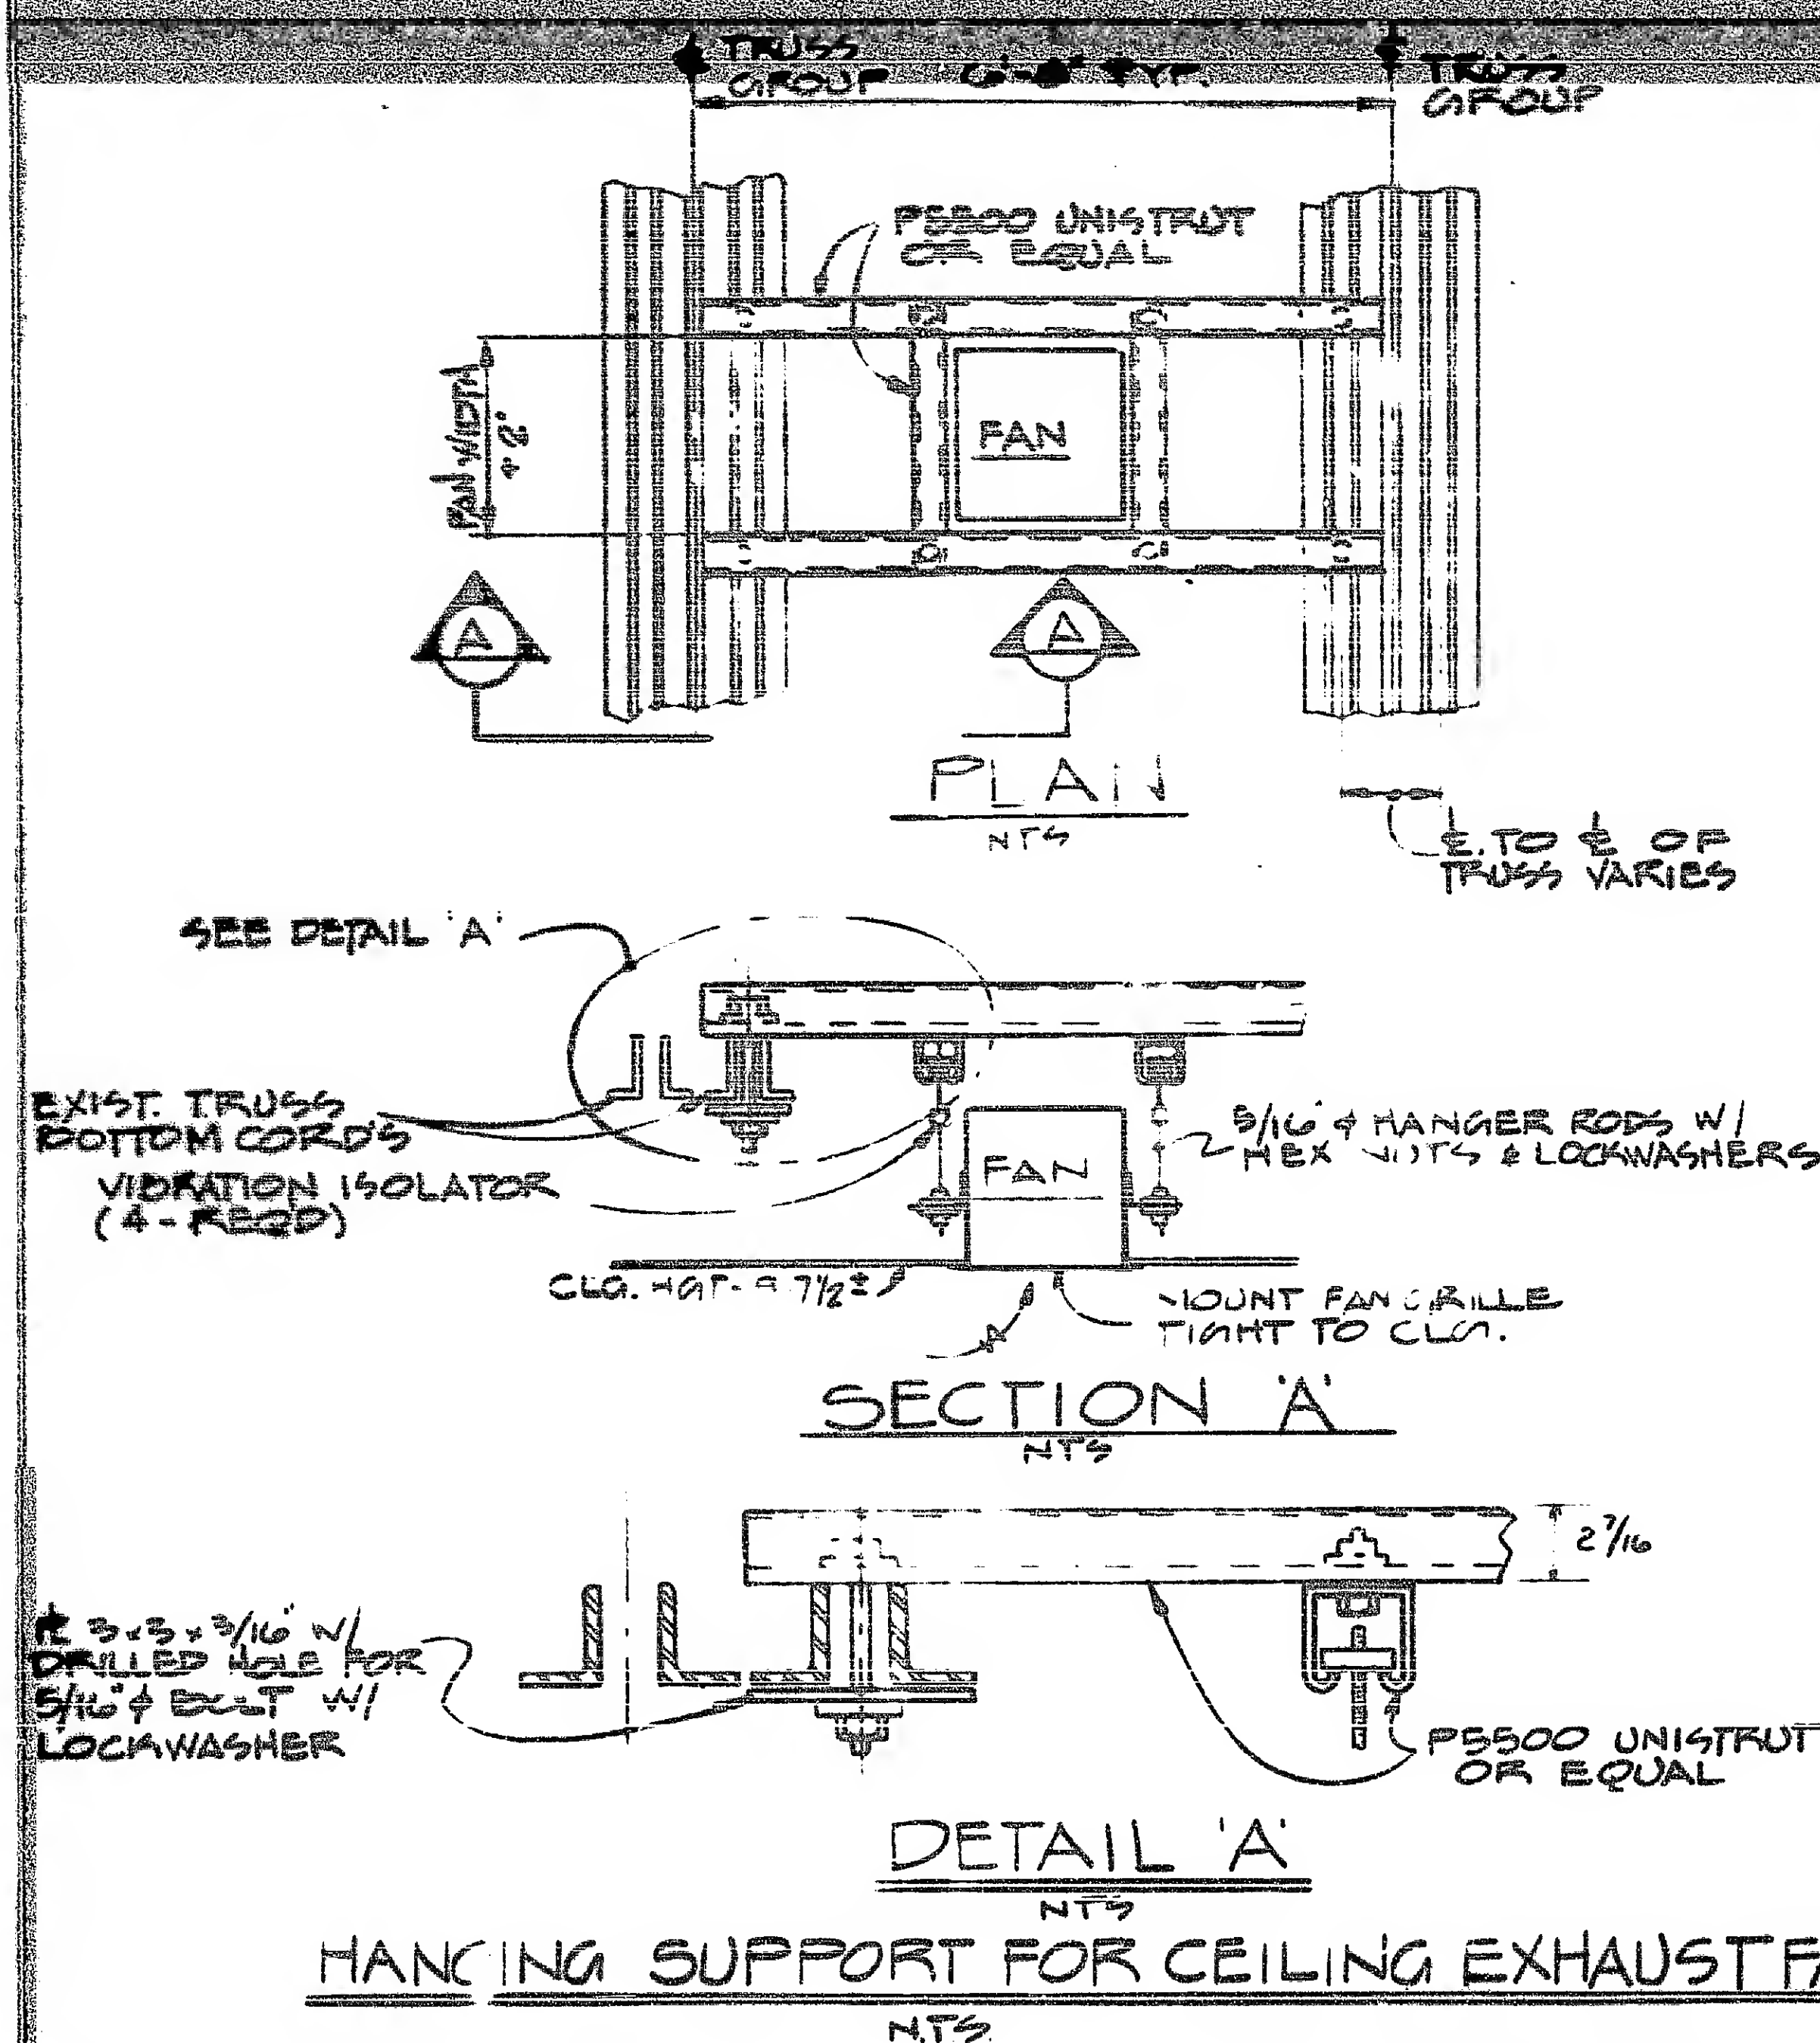
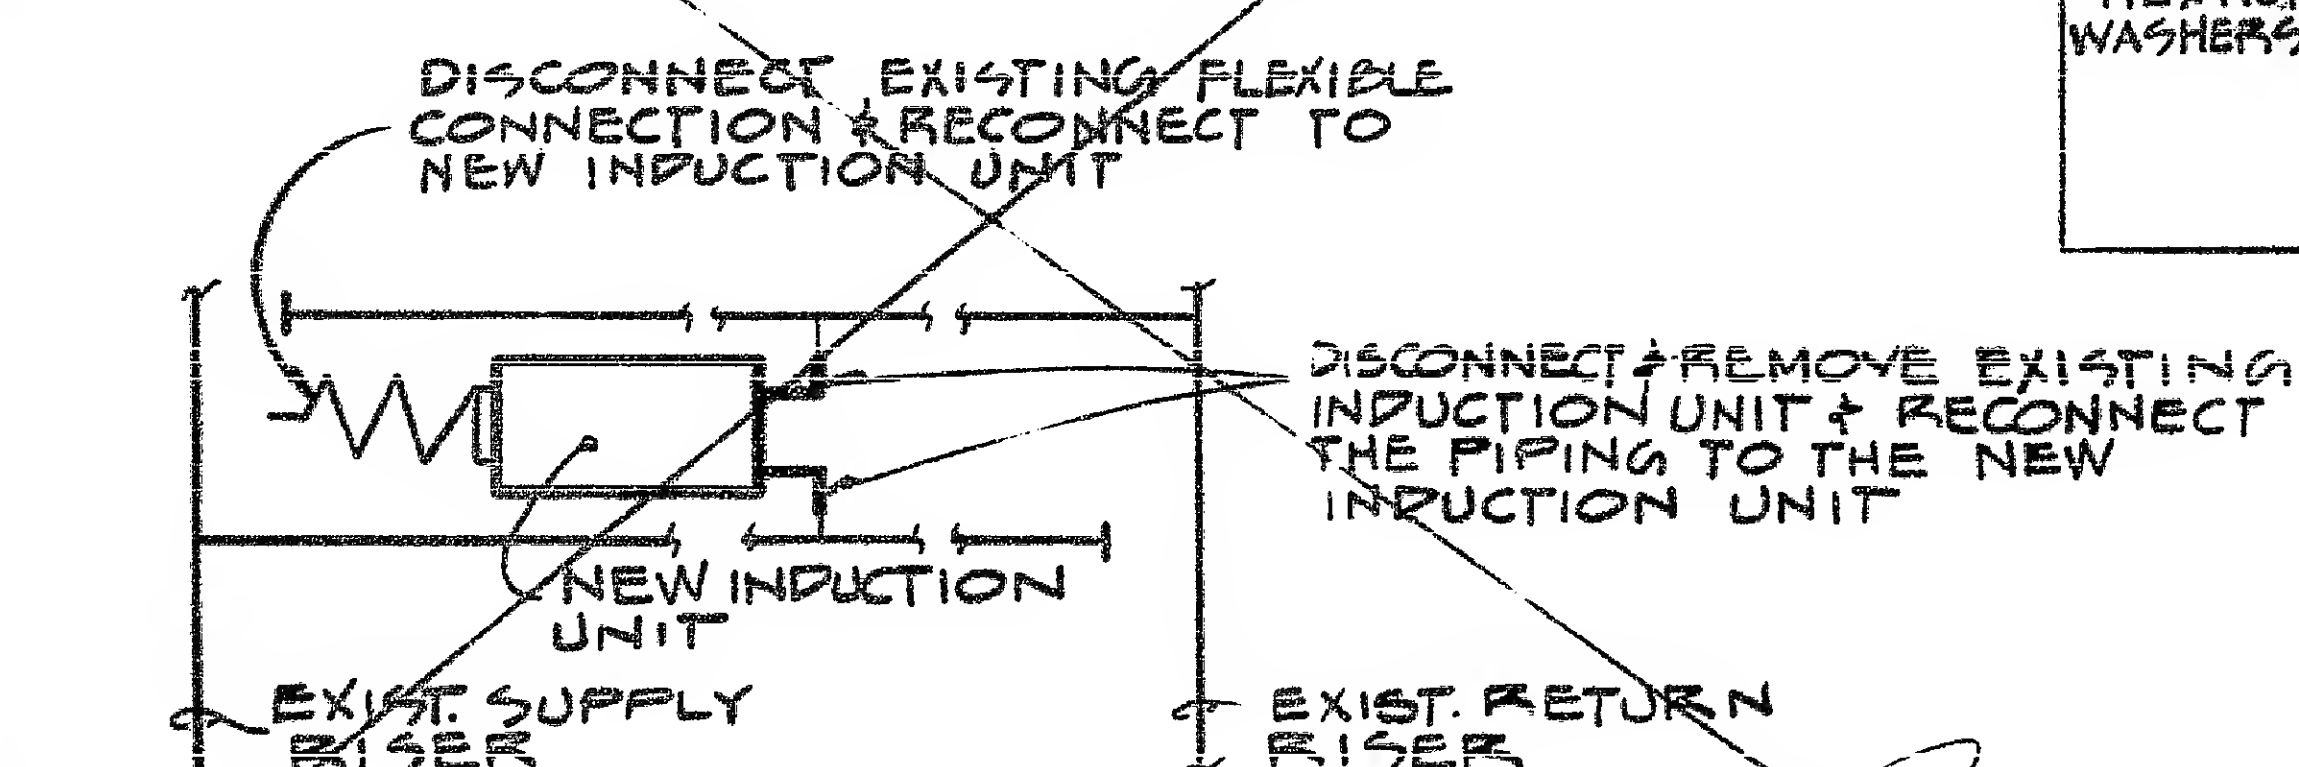


572.881




9-78

ALCO COOP


4-3 1/29/81

[illegible][illegible]

SCHEMATIC PIPING CONNECTIONS
TO NEW INDUCTION UNITS
NOMINAL COPPER PIPE SIZES
NO SCALE

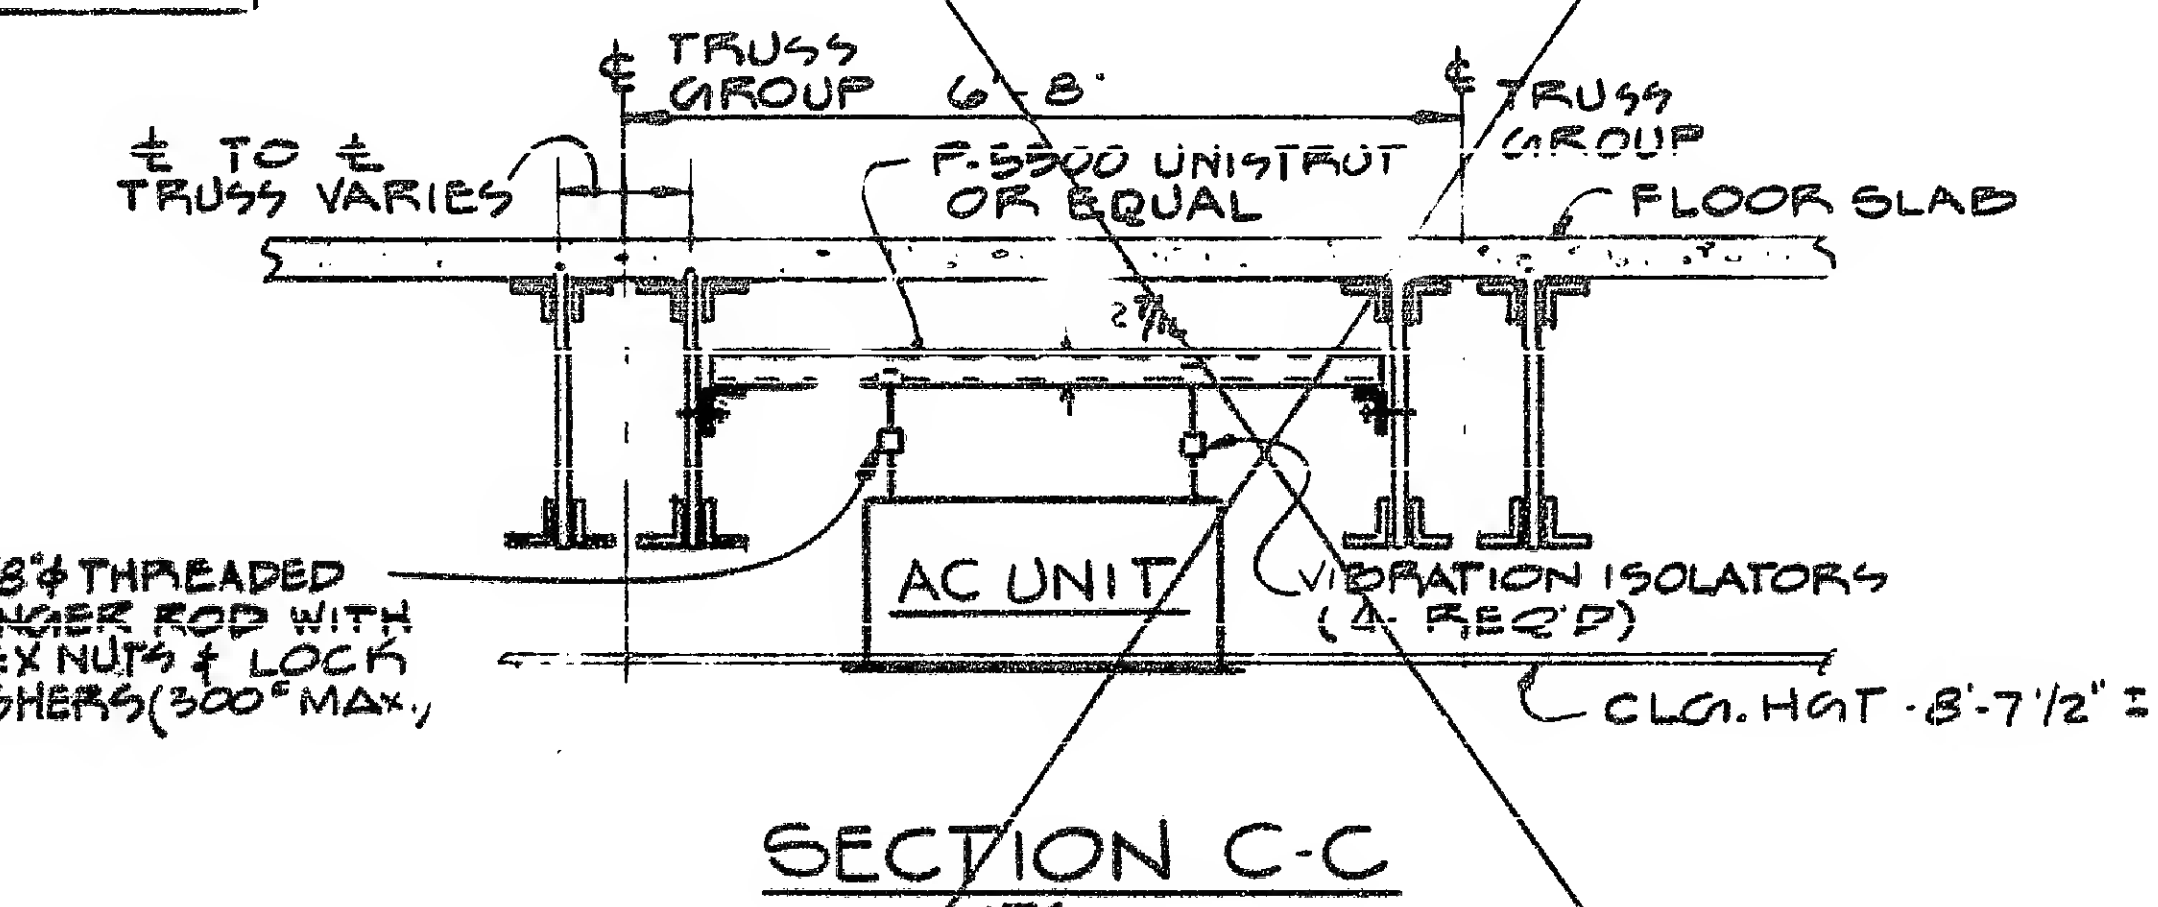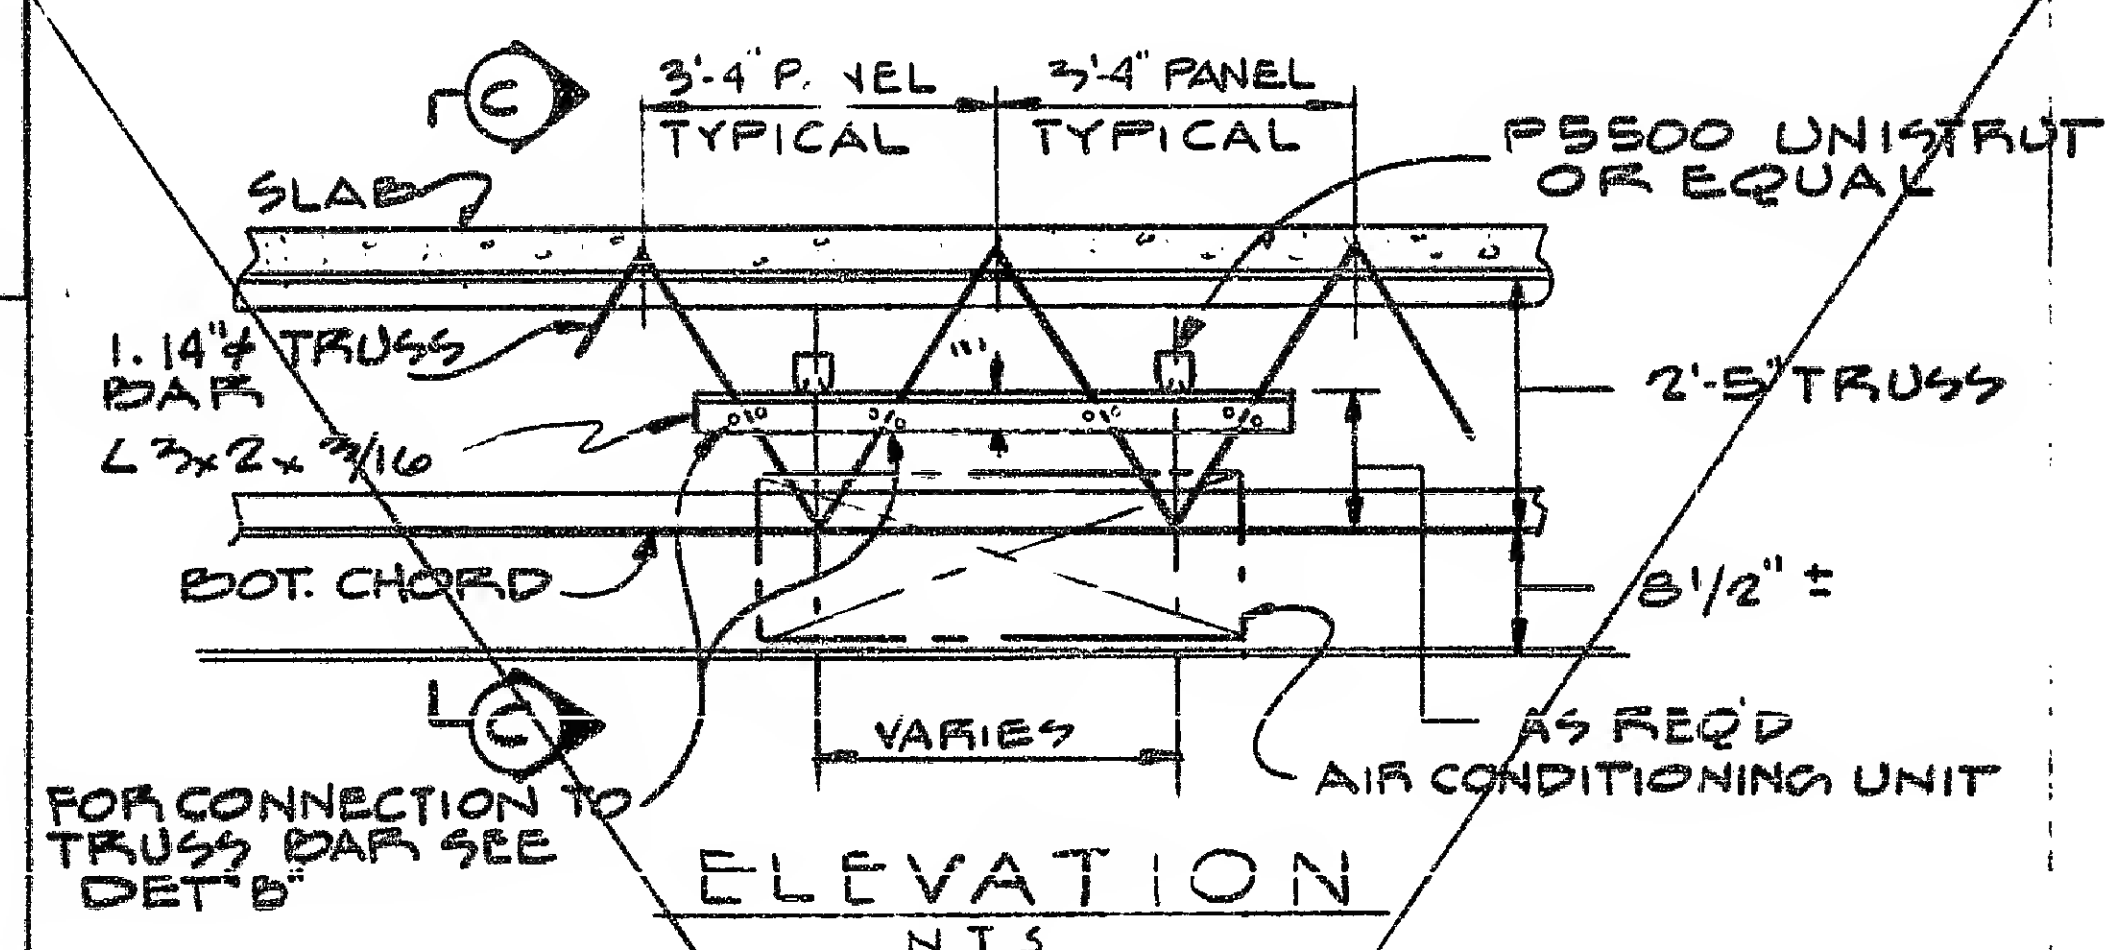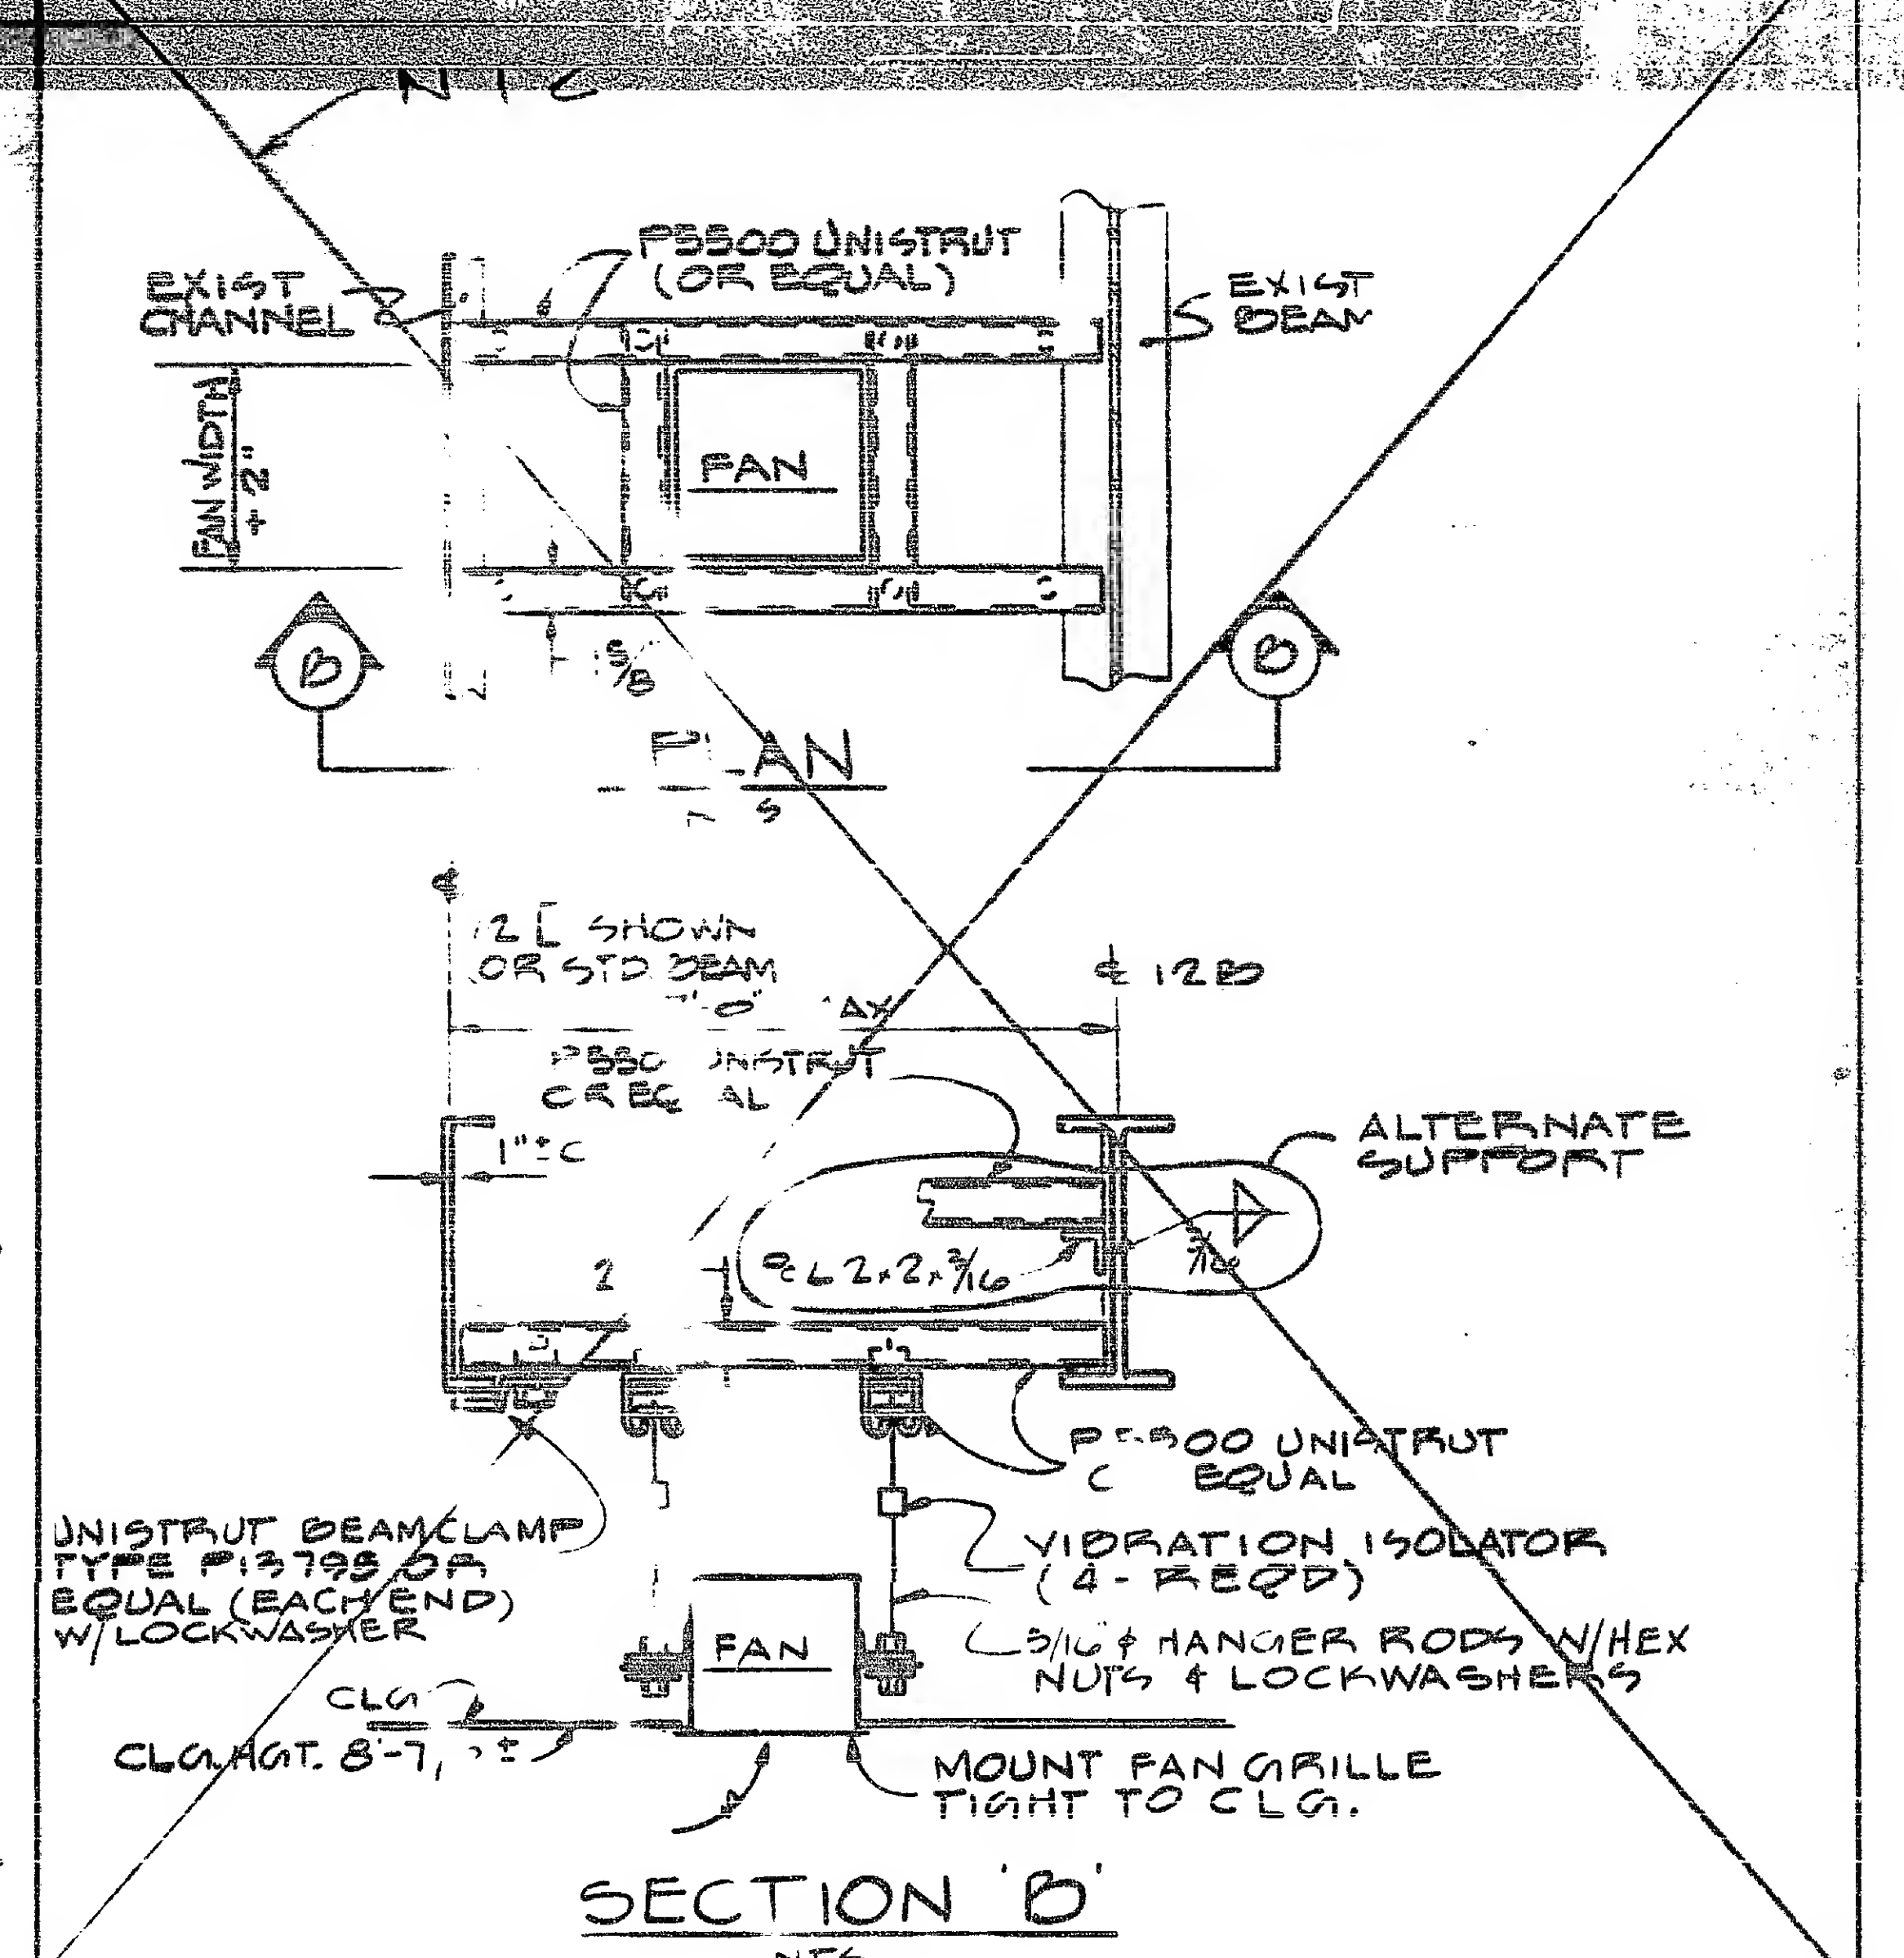

SECTION C-C

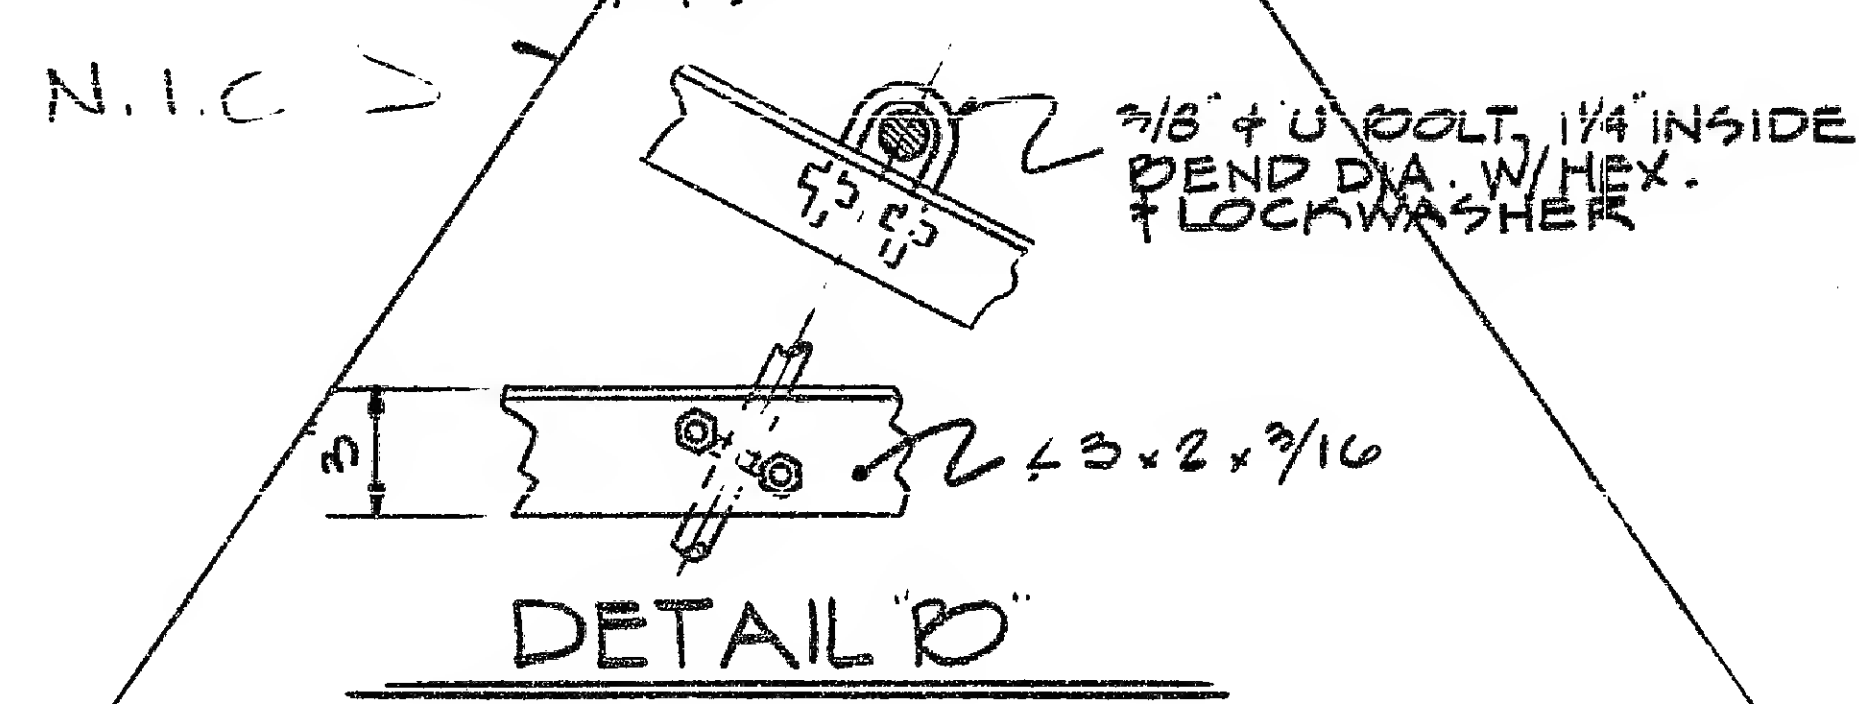

HANGING SUPPORT FOR AIR CONDITIONING UNIT

- | | |
|--|------------------------------|
| | NEW OR REPLACE |
| | EXIST. DOUBLE |
| | EXIST. DOUBLE |
| | NEW OR REPLACE |
| | EXIST. SINGLE |
| | EXIST. SINGLE |
| | NEW DUCTWORK |
| | EXIST. DUCTWORK |
| | NEW FLEXIBLE |
| | EXIST. FLEXIBLE |
| | EXIST. FLEXIBLE |
| | NEW FULL CAPACITY |
| | EXIST. FULL CAPACITY |
| | NEW ONE FOR ONE INDUCTION |
| | EXIST. ONE FOR ONE INDUCTION |
| | EXIST. FULL CAPACITY |
| | EXIST. FULL CAPACITY |
| | NEW CEILING DIFFUSER |
| | CEILING DIFFUSER |
| | CEILING DIFFUSER |
| | NEW CEILING DIFFUSER |
| | EXIST. CEILING DIFFUSER |
| | EXIST. CEILING DIFFUSER |
| | NEW THERMOSTAT |
| | EXIST. THERMOSTAT |
| | EXIST. THERMOSTAT |
| | NEW FAN SWITCH |
| | EXIST. FAN SWITCH |
| | EXIST. FAN SWITCH |
| | NEW SMOKE DETECTOR |
| | EXIST. SMOKE DETECTOR |
| | EXIST. SMOKE DETECTOR |
| | 1" (INCH) UNDER |
| | 1 1/2" (INCH) UNDER |
| | 1 SQUARE FOOT (FREE AREA) |
| | 2 SQUARE FEET (FREE AREA) |
| | NEW CONTROL |
| | EXIST. CONTROL |

DESIGNED BY	REVISIONS							
	NO.	DATE	APPD.	DESCRIPTION	NO.	DATE	APPD.	DESCRIPTION
DRAWN								
CHECKED								
APPROVED								
CHARGE								

[Signature]
ASST CHIEF ENGINEER
OF DESIGN

C. R. Tuck
ENGINEER OF DESIGN
AIRPORTS & WTC

DATE 12-23-80